


# Area Type Averages

Building type:Hotel/Casino. Building size:25K to less than 50K. Shifts:3

Area Type Averages				Normalized Weekly Lights On					Normalized Weekly Occupied					
Area Type	Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav	
Restroom	R	2	240	140.90	0.00	0.00	0.00	140.90	50.06	0.00	0.00	0.00	50.06	64.47%
Storage	S	2	258	84.67	0.00	0.00	0.00	84.67	0.73	0.00	0.00	0.00	0.73	99.14%
Gym	G	1	344	0.37	0.00	0.00	0.00	0.37	0.25	0.00	0.00	0.00	0.25	32.43%
Kitchen	K	3	631	144.05	0.00	0.00	0.00	144.05	114.51	0.00	0.00	0.00	114.51	20.51%
Office	O	1	344	53.45	0.00	0.00	0.00	53.45	31.51	0.00	0.00	0.00	31.51	41.05%
Shower Area	SH	1	120	37.05	0.00	0.00	0.00	37.05	14.26	0.00	0.00	0.00	14.26	61.51%
Utility	UT	9	296	46.85	0.00	0.00	0.00	46.85	27.96	0.00	0.00	0.00	27.96	40.32%
Building Average			6361	83.60			0.00	83.60	51.61			0.00	51.61	38.27%

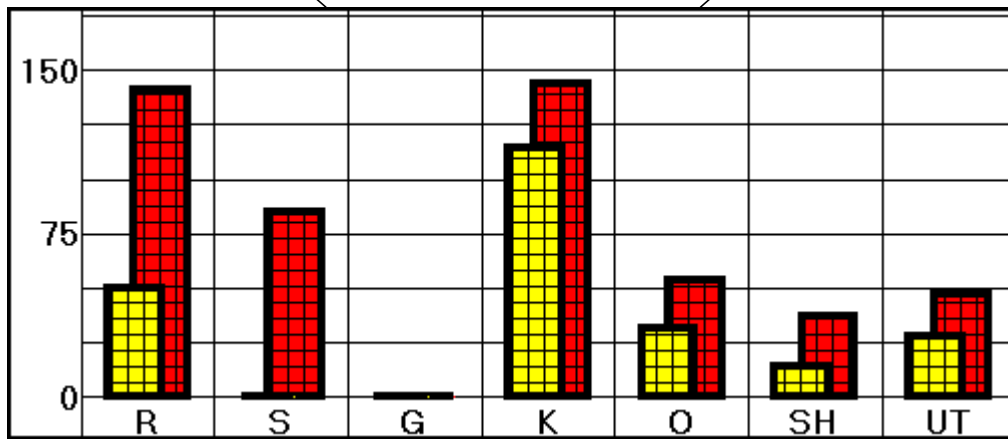

**Hours per Week for each Area Type**

Data Logger Detail Building type:Hotel/Casino. Building size:25K to less than 50K. Shifts:3 Page 1 of 1

All Loggers Listed			Hours Installed							Lights On					Occupied				
Logger	Area Type	Ty	Total	Peak	Off	Shldr 1	Shldr 2	Installed	Removed	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
20159	Shower Area	SH	360.17	360.17	0.00	0.00	0.00	9/15/05 3:02 PM	9/30/05 3:11 PM	79.43	0.00	0.00	0.00	79.43	30.57	0.00	0.00	0.00	30.57
20394	Kitchen	K	360.78	360.78	0.00	0.00	0.00	9/15/05 2:25 PM	9/30/05 3:11 PM	263.33	0.00	0.00	0.00	263.33	214.80	0.00	0.00	0.00	214.80
20046	Utility	UT	361.00	361.00	0.00	0.00	0.00	9/15/05 2:12 PM	9/30/05 3:11 PM	193.97	0.00	0.00	0.00	193.97	135.05	0.00	0.00	0.00	135.05
20141	Gym	G	360.85	360.85	0.00	0.00	0.00	9/15/05 2:21 PM	9/30/05 3:11 PM	0.80	0.00	0.00	0.00	0.80	0.53	0.00	0.00	0.00	0.53
20089	Kitchen	K	360.82	360.82	0.00	0.00	0.00	9/15/05 2:23 PM	9/30/05 3:11 PM	318.90	0.00	0.00	0.00	318.90	199.67	0.00	0.00	0.00	199.67
20288	Kitchen	K	360.75	360.75	0.00	0.00	0.00	9/15/05 2:27 PM	9/30/05 3:11 PM	345.83	0.00	0.00	0.00	345.83	323.23	0.00	0.00	0.00	323.23
20244	Restroom	R	361.05	361.05	0.00	0.00	0.00	9/15/05 2:10 PM	9/30/05 3:12 PM	303.88	0.00	0.00	0.00	303.88	88.58	0.00	0.00	0.00	88.58
20461	Utility	UT	342.40	342.40	0.00	0.00	0.00	9/16/05 8:48 AM	9/30/05 3:11 PM	16.57	0.00	0.00	0.00	16.57	5.73	0.00	0.00	0.00	5.73
20013	Utility	UT	360.58	360.58	0.00	0.00	0.00	9/15/05 2:37 PM	9/30/05 3:11 PM	38.80	0.00	0.00	0.00	38.80	6.67	0.00	0.00	0.00	6.67
20338	Utility	UT	360.55	360.55	0.00	0.00	0.00	9/15/05 2:41 PM	9/30/05 3:13 PM	45.90	0.00	0.00	0.00	45.90	6.57	0.00	0.00	0.00	6.57
20095	Utility	UT	360.72	360.72	0.00	0.00	0.00	9/15/05 2:29 PM	9/30/05 3:11 PM	89.83	0.00	0.00	0.00	89.83	26.23	0.00	0.00	0.00	26.23
20473	Utility	UT	360.00	360.00	0.00	0.00	0.00	9/15/05 3:11 PM	9/30/05 3:10 PM	57.87	0.00	0.00	0.00	57.87	36.80	0.00	0.00	0.00	36.80
20258	Utility	UT	340.15	340.15	0.00	0.00	0.00	9/16/05 11:03 AM	9/30/05 3:11 PM	4.00	0.00	0.00	0.00	4.00	2.43	0.00	0.00	0.00	2.43
20465	Utility	UT	359.92	359.92	0.00	0.00	0.00	9/15/05 3:17 PM	9/30/05 3:11 PM	96.67	0.00	0.00	0.00	96.67	33.20	0.00	0.00	0.00	33.20
20365	Utility	UT	360.95	360.95	0.00	0.00	0.00	9/15/05 2:18 PM	9/30/05 3:14 PM	360.63	0.00	0.00	0.00	360.63	287.27	0.00	0.00	0.00	287.27
20207	Office	O	360.62	360.62	0.00	0.00	0.00	9/15/05 2:35 PM	9/30/05 3:11 PM	114.73	0.00	0.00	0.00	114.73	67.63	0.00	0.00	0.00	67.63
20420	Restroom	R	361.08	361.08	0.00	0.00	0.00	9/15/05 2:07 PM	9/30/05 3:11 PM	301.73	0.00	0.00	0.00	301.73	126.60	0.00	0.00	0.00	126.60
20015	Storage	S	246.25	246.25	0.00	0.00	0.00	9/20/05 9:00 AM	9/30/05 3:14 PM	246.23	0.00	0.00	0.00	246.23	0.17	0.00	0.00	0.00	0.17
20017	Storage	S	344.45	344.45	0.00	0.00	0.00	9/16/05 6:45 AM	9/30/05 3:11 PM	2.77	0.00	0.00	0.00	2.77	2.77	0.00	0.00	0.00	2.77

All Loggers Listed			Load	Normalized Weekly Hours of Use					Normalized Weekly Hours of Occupancy					
Logger	Area Type	Ty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav
20159	Shower Area	SH	120	37.05	0.00	0.00	0.00	37.05	14.26	0.00	0.00	0.00	14.26	61.51%
20394	Kitchen	K	860	122.62	0.00	0.00	0.00	122.62	100.02	0.00	0.00	0.00	100.02	18.43%
20046	Utility	UT	430	90.27	0.00	0.00	0.00	90.27	62.85	0.00	0.00	0.00	62.85	30.38%
20141	Gym	G	344	0.37	0.00	0.00	0.00	0.37	0.25	0.00	0.00	0.00	0.25	32.43%
20089	Kitchen	K	688	148.48	0.00	0.00	0.00	148.48	92.97	0.00	0.00	0.00	92.97	37.39%
20288	Kitchen	K	344	161.05	0.00	0.00	0.00	161.05	150.53	0.00	0.00	0.00	150.53	6.53%
20244	Restroom	R	240	141.40	0.00	0.00	0.00	141.40	41.22	0.00	0.00	0.00	41.22	70.85%
20461	Utility	UT	172	8.13	0.00	0.00	0.00	8.13	2.81	0.00	0.00	0.00	2.81	65.44%
20013	Utility	UT	172	18.08	0.00	0.00	0.00	18.08	3.11	0.00	0.00	0.00	3.11	82.80%
20338	Utility	UT	172	21.39	0.00	0.00	0.00	21.39	3.06	0.00	0.00	0.00	3.06	85.69%
20095	Utility	UT	172	41.84	0.00	0.00	0.00	41.84	12.22	0.00	0.00	0.00	12.22	70.79%
20473	Utility	UT	344	27.00	0.00	0.00	0.00	27.00	17.17	0.00	0.00	0.00	17.17	36.41%
20258	Utility	UT	344	1.98	0.00	0.00	0.00	1.98	1.20	0.00	0.00	0.00	1.20	39.39%
20465	Utility	UT	344	45.12	0.00	0.00	0.00	45.12	15.50	0.00	0.00	0.00	15.50	65.65%
20365	Utility	UT	516	167.85	0.00	0.00	0.00	167.85	133.70	0.00	0.00	0.00	133.70	20.35%
20207	Office	O	344	53.45	0.00	0.00	0.00	53.45	31.51	0.00	0.00	0.00	31.51	41.05%
20420	Restroom	R	240	140.39	0.00	0.00	0.00	140.39	58.90	0.00	0.00	0.00	58.90	58.05%
20015	Storage	S	172	167.99	0.00	0.00	0.00	167.99	0.11	0.00	0.00	0.00	0.11	99.93%
20017	Storage	S	344	1.35	0.00	0.00	0.00	1.35	1.35	0.00	0.00	0.00	1.35	0.00%

Building Summary Totals Building type:Hotel/Casino. Building size:25K to less than 50K. Shifts:3 Page 1 of 1

Building Summary Totals				Lights On KWHR					Occupied KWHR				
Area Type		Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
Restroom	R	2	480	68	0	0	0	68	24	0	0	0	24
Storage	S	2	516	44	0	0	0	44	0	0	0	0	0
Gym	G	1	344	0	0	0	0	0	0	0	0	0	0
Kitchen	K	3	1893	273	0	0	0	273	217	0	0	0	217
Office	O	1	344	18	0	0	0	18	11	0	0	0	11
Shower Area	SH	1	120	4	0	0	0	4	2	0	0	0	2
Utility	UT	9	2664	125	0	0	0	125	74	0	0	0	74
Building Totals			6361	532			0	532	328			0	328