


Area Type Averages

Building type:Light/High Tech Manufg. Building size:100K to less than 250K. Shifts:2

Area Type Averages			Normalized Weekly Lights On					Normalized Weekly Occupied						
Area Type	Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav	
Storage	S	9	4966	162.04	0.00	0.00	0.00	162.04	83.85	0.00	0.00	0.00	83.85	48.25%
Hallway	H	1	940	93.00	0.00	0.00	0.00	93.00	76.29	0.00	0.00	0.00	76.29	17.97%
Mechanical Room /	MR	11	1552	154.62	0.00	0.00	0.00	154.62	19.26	0.00	0.00	0.00	19.26	87.54%
Gym	G	1	3008	112.88	0.00	0.00	0.00	112.88	44.20	0.00	0.00	0.00	44.20	60.84%
Office	O	15	1391	75.62	0.00	0.00	0.00	75.62	45.30	0.00	0.00	0.00	45.30	40.10%
Building Average			86579	137.29			0.00	137.29	60.36			0.00	60.36	56.03%

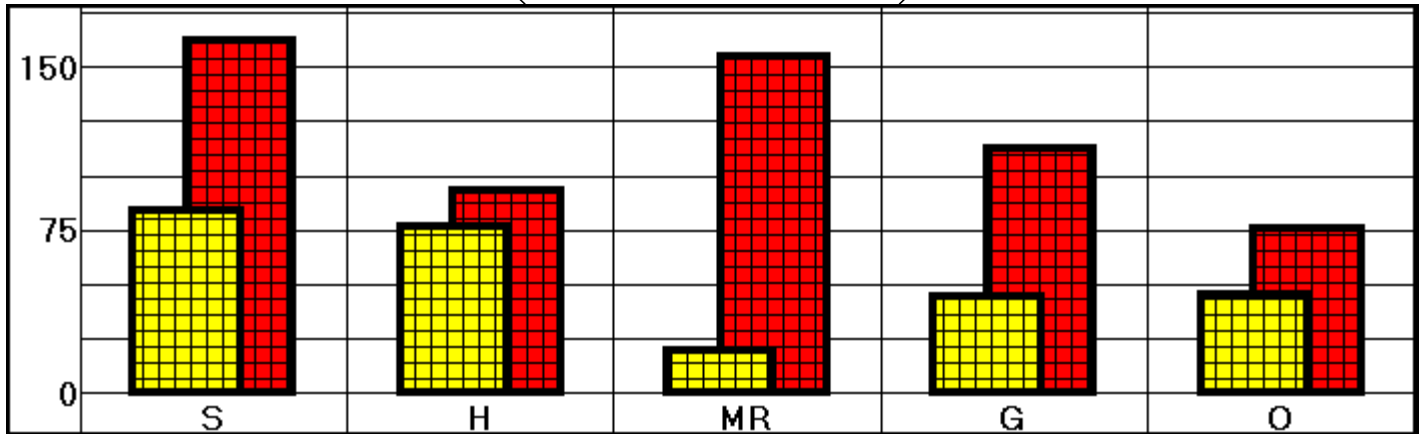

Hours per Week for each Area Type

Data Logger Detail Building type:Light/High Tech Manufg. Building size:100K to less than 250K. Shifts:2 Page 1 of 1

All Loggers Listed			Hours Installed							Lights On					Occupied				
Logger	Area Type	Ty	Total	Peak	Off	Shldr 1	Shldr 2	Installed	Removed	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
23528	Office	O	551.93	551.93	0.00	0.00	0.00	10/05/05 8:06 AM	10/28/05 8:01 AM	60.37	0.00	0.00	0.00	60.37	49.30	0.00	0.00	0.00	49.30
23835	Office	O	545.92	545.92	0.00	0.00	0.00	10/05/05 2:07 PM	10/28/05 8:01 AM	62.70	0.00	0.00	0.00	62.70	22.13	0.00	0.00	0.00	22.13
20799	Office	O	547.98	547.98	0.00	0.00	0.00	10/05/05 12:04	10/28/05 8:02 AM	43.63	0.00	0.00	0.00	43.63	25.23	0.00	0.00	0.00	25.23
22582	Office	O	552.38	552.38	0.00	0.00	0.00	10/05/05 7:46 AM	10/28/05 8:08 AM	115.27	0.00	0.00	0.00	115.27	66.60	0.00	0.00	0.00	66.60
21563	Mechanical Room / Storage	MR	551.93	551.93	0.00	0.00	0.00	10/05/05 8:27 AM	10/28/05 8:22 AM	551.92	0.00	0.00	0.00	551.92	94.27	0.00	0.00	0.00	94.27
21915	Mechanical Room / Storage	MR	543.30	543.30	0.00	0.00	0.00	10/05/05 5:02 PM	10/28/05 8:19 AM	543.28	0.00	0.00	0.00	543.28	45.67	0.00	0.00	0.00	45.67
23856	Gym	G	552.15	552.15	0.00	0.00	0.00	10/05/05 8:04 AM	10/28/05 8:12 AM	371.00	0.00	0.00	0.00	371.00	145.27	0.00	0.00	0.00	145.27
24632	Office	O	485.13	485.13	0.00	0.00	0.00	10/05/05 7:45 AM	10/25/05 12:52	483.15	0.00	0.00	0.00	483.15	229.83	0.00	0.00	0.00	229.83
24312	Storage	S	551.92	551.92	0.00	0.00	0.00	10/05/05 8:31 AM	10/28/05 8:25 AM	551.90	0.00	0.00	0.00	551.90	71.87	0.00	0.00	0.00	71.87
23474	Storage	S	551.77	551.77	0.00	0.00	0.00	10/05/05 8:45 AM	10/28/05 8:30 AM	551.05	0.00	0.00	0.00	551.05	503.88	0.00	0.00	0.00	503.88
23911	Office	O	551.70	551.70	0.00	0.00	0.00	10/05/05 9:08 AM	10/28/05 8:49 AM	322.08	0.00	0.00	0.00	322.08	193.20	0.00	0.00	0.00	193.20
24352	Office	O	551.72	551.72	0.00	0.00	0.00	10/05/05 9:09 AM	10/28/05 8:51 AM	353.37	0.00	0.00	0.00	353.37	222.65	0.00	0.00	0.00	222.65
24262	Office	O	551.72	551.72	0.00	0.00	0.00	10/05/05 9:06 AM	10/28/05 8:48 AM	406.53	0.00	0.00	0.00	406.53	244.13	0.00	0.00	0.00	244.13
24310	Office	O	551.67	551.67	0.00	0.00	0.00	10/05/05 9:11 AM	10/28/05 8:50 AM	329.82	0.00	0.00	0.00	329.82	207.02	0.00	0.00	0.00	207.02
24095	Mechanical Room / Storage	MR	551.85	551.85	0.00	0.00	0.00	10/05/05 8:39 AM	10/28/05 8:29 AM	551.83	0.00	0.00	0.00	551.83	49.17	0.00	0.00	0.00	49.17
21520	Mechanical Room / Storage	MR	552.07	552.07	0.00	0.00	0.00	10/05/05 8:15 AM	10/28/05 8:18 AM	504.95	0.00	0.00	0.00	504.95	188.42	0.00	0.00	0.00	188.42
24373	Mechanical Room / Storage	MR	534.30	534.30	0.00	0.00	0.00	10/06/05 2:00 AM	10/28/05 8:17 AM	112.03	0.00	0.00	0.00	112.03	48.23	0.00	0.00	0.00	48.23
24011	Mechanical Room / Storage	MR	551.82	551.82	0.00	0.00	0.00	10/05/05 8:41 AM	10/28/05 8:29 AM	551.77	0.00	0.00	0.00	551.77	26.53	0.00	0.00	0.00	26.53
23821	Mechanical Room / Storage	MR	551.78	551.78	0.00	0.00	0.00	10/05/05 8:43 AM	10/28/05 8:29 AM	551.77	0.00	0.00	0.00	551.77	50.20	0.00	0.00	0.00	50.20
24148	Mechanical Room / Storage	MR	551.72	551.72	0.00	0.00	0.00	10/05/05 8:49 AM	10/28/05 8:31 AM	551.70	0.00	0.00	0.00	551.70	46.93	0.00	0.00	0.00	46.93
23808	Mechanical Room / Storage	MR	548.05	548.05	0.00	0.00	0.00	10/05/05 12:30	10/28/05 8:32 AM	548.03	0.00	0.00	0.00	548.03	41.57	0.00	0.00	0.00	41.57
22877	Mechanical Room / Storage	MR	551.97	551.97	0.00	0.00	0.00	10/05/05 8:25 AM	10/28/05 8:22 AM	551.95	0.00	0.00	0.00	551.95	78.83	0.00	0.00	0.00	78.83
23936	Hallway	H	552.22	552.22	0.00	0.00	0.00	10/05/05 7:49 AM	10/28/05 8:01 AM	305.68	0.00	0.00	0.00	305.68	250.75	0.00	0.00	0.00	250.75
23881	Office	O	552.18	552.18	0.00	0.00	0.00	10/05/05 7:59 AM	10/28/05 8:09 AM	88.35	0.00	0.00	0.00	88.35	79.72	0.00	0.00	0.00	79.72
24092	Office	O	625.95	625.95	0.00	0.00	0.00	10/05/05 7:57 AM	10/31/05 9:53 AM	164.90	0.00	0.00	0.00	164.90	105.90	0.00	0.00	0.00	105.90
23999	Mechanical Room / Storage	MR	551.85	551.85	0.00	0.00	0.00	10/05/05 8:37 AM	10/28/05 8:27 AM	551.83	0.00	0.00	0.00	551.83	23.50	0.00	0.00	0.00	23.50
21002	Storage	S	551.62	551.62	0.00	0.00	0.00	10/05/05 8:58 AM	10/28/05 8:34 AM	551.60	0.00	0.00	0.00	551.60	144.98	0.00	0.00	0.00	144.98
23858	Storage	S	551.62	551.62	0.00	0.00	0.00	10/05/05 8:57 AM	10/28/05 8:33 AM	551.60	0.00	0.00	0.00	551.60	129.07	0.00	0.00	0.00	129.07
20884	Storage	S	551.58	551.58	0.00	0.00	0.00	10/05/05 9:01 AM	10/28/05 8:35 AM	551.43	0.00	0.00	0.00	551.43	551.43	0.00	0.00	0.00	551.43
24067	Office	O	552.10	552.10	0.00	0.00	0.00	10/05/05 8:08 AM	10/28/05 8:13 AM	314.45	0.00	0.00	0.00	314.45	243.90	0.00	0.00	0.00	243.90
22728	Office	O	552.12	552.12	0.00	0.00	0.00	10/05/05 8:09 AM	10/28/05 8:15 AM	280.87	0.00	0.00	0.00	280.87	203.70	0.00	0.00	0.00	203.70
22852	Storage	S	551.57	551.57	0.00	0.00	0.00	10/05/05 9:03 AM	10/28/05 8:36 AM	551.55	0.00	0.00	0.00	551.55	196.33	0.00	0.00	0.00	196.33
24350	Storage	S	552.40	552.40	0.00	0.00	0.00	10/05/05 8:19 AM	10/28/05 8:42 AM	552.35	0.00	0.00	0.00	552.35	504.68	0.00	0.00	0.00	504.68
21617	Storage	S	625.13	625.13	0.00	0.00	0.00	10/05/05 8:46 AM	10/31/05 9:53 AM	615.83	0.00	0.00	0.00	615.83	370.43	0.00	0.00	0.00	370.43
23551	Office	O	551.90	551.90	0.00	0.00	0.00	10/05/05 8:20 AM	10/28/05 8:13 AM	511.12	0.00	0.00	0.00	511.12	272.73	0.00	0.00	0.00	272.73
24028	Office	O	552.42	552.42	0.00	0.00	0.00	10/05/05 7:47 AM	10/28/05 8:11 AM	141.53	0.00	0.00	0.00	141.53	46.70	0.00	0.00	0.00	46.70
24293	Storage	S	552.05	552.05	0.00	0.00	0.00	10/05/05 8:17 AM	10/28/05 8:19 AM	385.10	0.00	0.00	0.00	385.10	49.73	0.00	0.00	0.00	49.73

All Loggers Listed			Load	Normalized Weekly Hours of Use					Normalized Weekly Hours of Occupancy					
Logger	Area Type	Ty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav
23528	Office	O	564	18.37	0.00	0.00	0.00	18.37	15.01	0.00	0.00	0.00	15.01	18.29%
23835	Office	O	1316	19.30	0.00	0.00	0.00	19.30	6.81	0.00	0.00	0.00	6.81	64.72%
20799	Office	O	1316	13.38	0.00	0.00	0.00	13.38	7.74	0.00	0.00	0.00	7.74	42.15%
22582	Office	O	752	35.06	0.00	0.00	0.00	35.06	20.26	0.00	0.00	0.00	20.26	42.21%
21563	Mechanical	MR	2400	167.99	0.00	0.00	0.00	167.99	28.69	0.00	0.00	0.00	28.69	82.92%
21915	Mechanical	MR	2595	167.99	0.00	0.00	0.00	167.99	14.12	0.00	0.00	0.00	14.12	91.59%
23856	Gym	G	3008	112.88	0.00	0.00	0.00	112.88	44.20	0.00	0.00	0.00	44.20	60.84%
24632	Office	O	1692	167.31	0.00	0.00	0.00	167.31	79.59	0.00	0.00	0.00	79.59	52.43%
24312	Storage	S	20250	167.99	0.00	0.00	0.00	167.99	21.88	0.00	0.00	0.00	21.88	86.98%
23474	Storage	S	2000	167.78	0.00	0.00	0.00	167.78	153.42	0.00	0.00	0.00	153.42	8.56%
23911	Office	O	1692	98.08	0.00	0.00	0.00	98.08	58.83	0.00	0.00	0.00	58.83	40.02%
24352	Office	O	1692	107.60	0.00	0.00	0.00	107.60	67.80	0.00	0.00	0.00	67.80	36.99%
24262	Office	O	1692	123.79	0.00	0.00	0.00	123.79	74.34	0.00	0.00	0.00	74.34	39.95%
24310	Office	O	1692	100.44	0.00	0.00	0.00	100.44	63.04	0.00	0.00	0.00	63.04	37.24%
24095	Mechanical	MR	960	167.99	0.00	0.00	0.00	167.99	14.97	0.00	0.00	0.00	14.97	91.09%
21520	Mechanical	MR	3806	153.66	0.00	0.00	0.00	153.66	57.34	0.00	0.00	0.00	57.34	62.68%
24373	Mechanical	MR	1384	35.23	0.00	0.00	0.00	35.23	15.17	0.00	0.00	0.00	15.17	56.94%
24011	Mechanical	MR	800	167.98	0.00	0.00	0.00	167.98	8.08	0.00	0.00	0.00	8.08	95.19%
23821	Mechanical	MR	800	167.99	0.00	0.00	0.00	167.99	15.28	0.00	0.00	0.00	15.28	90.90%
24148	Mechanical	MR	900	167.99	0.00	0.00	0.00	167.99	14.29	0.00	0.00	0.00	14.29	91.49%
23808	Mechanical	MR	900	167.99	0.00	0.00	0.00	167.99	12.74	0.00	0.00	0.00	12.74	92.42%
22877	Mechanical	MR	1730	167.99	0.00	0.00	0.00	167.99	23.99	0.00	0.00	0.00	23.99	85.72%
23936	Hallway	H	940	93.00	0.00	0.00	0.00	93.00	76.29	0.00	0.00	0.00	76.29	17.97%
23881	Office	O	564	26.88	0.00	0.00	0.00	26.88	24.25	0.00	0.00	0.00	24.25	9.78%
24092	Office	O	564	44.26	0.00	0.00	0.00	44.26	28.42	0.00	0.00	0.00	28.42	35.79%
23999	Mechanical	MR	800	167.99	0.00	0.00	0.00	167.99	7.15	0.00	0.00	0.00	7.15	95.74%
21002	Storage	S	1500	167.99	0.00	0.00	0.00	167.99	44.16	0.00	0.00	0.00	44.16	73.71%
23858	Storage	S	1500	167.99	0.00	0.00	0.00	167.99	39.31	0.00	0.00	0.00	39.31	76.60%
20884	Storage	S	1500	167.95	0.00	0.00	0.00	167.95	167.95	0.00	0.00	0.00	167.95	0.00%
24067	Office	O	1504	95.68	0.00	0.00	0.00	95.68	74.22	0.00	0.00	0.00	74.22	22.43%
22728	Office	O	2256	85.46	0.00	0.00	0.00	85.46	61.98	0.00	0.00	0.00	61.98	27.47%
22852	Storage	S	4800	167.99	0.00	0.00	0.00	167.99	59.80	0.00	0.00	0.00	59.80	64.40%
24350	Storage	S	8000	167.98	0.00	0.00	0.00	167.98	153.49	0.00	0.00	0.00	153.49	8.63%
21617	Storage	S	4800	165.50	0.00	0.00	0.00	165.50	99.55	0.00	0.00	0.00	99.55	39.85%
23551	Office	O	2256	155.59	0.00	0.00	0.00	155.59	83.02	0.00	0.00	0.00	83.02	46.64%
24028	Office	O	1316	43.04	0.00	0.00	0.00	43.04	14.20	0.00	0.00	0.00	14.20	67.01%
24293	Storage	S	346	117.19	0.00	0.00	0.00	117.19	15.13	0.00	0.00	0.00	15.13	87.09%

Building Summary Totals			Lights On KWHR					Occupied KWHR					
Area Type	Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	
Storage	S	9	44694	7242	0	0	0	7242	3748	0	0	0	3748
Hallway	H	1	940	87	0	0	0	87	72	0	0	0	72
Mechanical Room /	MR	11	17072	2640	0	0	0	2640	329	0	0	0	329
Gym	G	1	3008	340	0	0	0	340	133	0	0	0	133
Office	O	15	20865	1578	0	0	0	1578	945	0	0	0	945
Building Totals			86579	11887			0	11887	5226			0	5226