


Area Type Averages

Building type:Office. Building size:50K to less than 100K. Shifts:1

Area Type Averages				Normalized Weekly Lights On					Normalized Weekly Occupied						
Area Type	Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav		
Hallway	H	14	125	168.00	0.00	0.00	0.00	168.00	40.67	0.00	0.00	0.00	40.67	75.79%	
Lobby	LB	6	181	152.24	0.00	0.00	0.00	152.24	62.11	0.00	0.00	0.00	62.11	59.20%	
Building Average		2836	161.97				0.00	161.97	48.88				0.00	48.88	69.82%

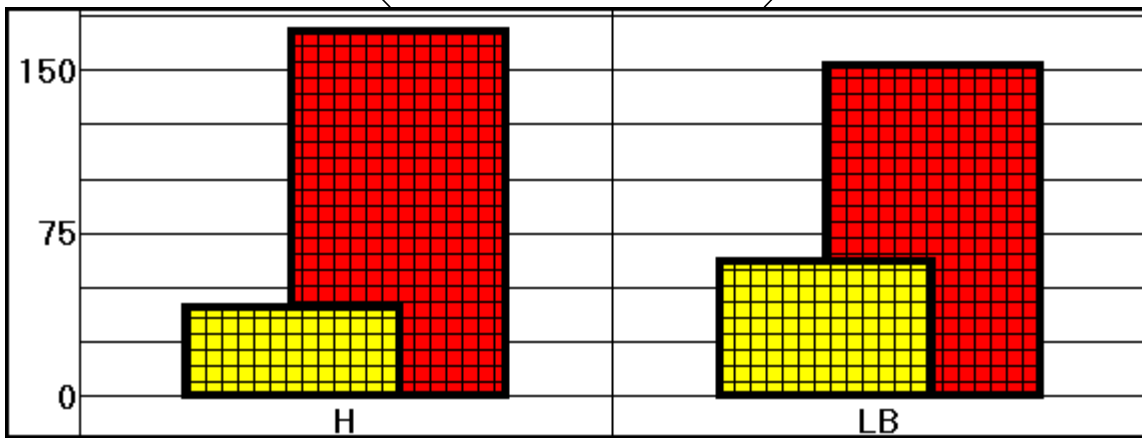

Hours per Week for each Area Type

Data Logger Detail Building type:Office. Building size:50K to less than 100K. Shifts:1

All Loggers Listed			Hours Installed					Lights On					Occupied						
Logger	Area Type	Ty	Total	Peak	Off	Shldr 1	Shldr 2	Installed	Removed	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
23953	Lobby	LB	339.38	339.38	0.00	0.00	0.00	9/27/05 10:38 AM	10/11/05 2:00 PM	339.38	0.00	0.00	0.00	339.38	134.83	0.00	0.00	0.00	134.83
24197	Hallway	H	339.33	339.33	0.00	0.00	0.00	9/27/05 10:41 AM	10/11/05 2:00 PM	339.33	0.00	0.00	0.00	339.33	100.10	0.00	0.00	0.00	100.10
24134	Hallway	H	339.32	339.32	0.00	0.00	0.00	9/27/05 10:42 AM	10/11/05 2:00 PM	339.32	0.00	0.00	0.00	339.32	117.05	0.00	0.00	0.00	117.05
23384	Hallway	H	339.30	339.30	0.00	0.00	0.00	9/27/05 10:43 AM	10/11/05 2:00 PM	339.30	0.00	0.00	0.00	339.30	72.97	0.00	0.00	0.00	72.97
23905	Hallway	H	339.28	339.28	0.00	0.00	0.00	9/27/05 10:44 AM	10/11/05 2:00 PM	339.28	0.00	0.00	0.00	339.28	72.65	0.00	0.00	0.00	72.65
24232	Hallway	H	339.17	339.17	0.00	0.00	0.00	9/27/05 10:51 AM	10/11/05 2:00 PM	339.17	0.00	0.00	0.00	339.17	0.37	0.00	0.00	0.00	0.37
22363	Lobby	LB	339.60	339.60	0.00	0.00	0.00	9/27/05 10:25 AM	10/11/05 2:00 PM	339.60	0.00	0.00	0.00	339.60	145.80	0.00	0.00	0.00	145.80
24133	Hallway	H	339.52	339.52	0.00	0.00	0.00	9/27/05 10:30 AM	10/11/05 2:00 PM	339.52	0.00	0.00	0.00	339.52	114.05	0.00	0.00	0.00	114.05
23939	Hallway	H	339.47	339.47	0.00	0.00	0.00	9/27/05 10:33 AM	10/11/05 2:00 PM	339.47	0.00	0.00	0.00	339.47	71.93	0.00	0.00	0.00	71.93
24258	Hallway	H	339.03	339.03	0.00	0.00	0.00	9/27/05 10:59 AM	10/11/05 2:00 PM	339.03	0.00	0.00	0.00	339.03	72.55	0.00	0.00	0.00	72.55
24107	Hallway	H	339.47	339.47	0.00	0.00	0.00	9/27/05 10:33 AM	10/11/05 2:00 PM	339.47	0.00	0.00	0.00	339.47	72.38	0.00	0.00	0.00	72.38
22559	Lobby	LB	339.85	339.85	0.00	0.00	0.00	9/27/05 10:10 AM	10/11/05 2:00 PM	339.85	0.00	0.00	0.00	339.85	136.05	0.00	0.00	0.00	136.05
23838	Lobby	LB	338.98	338.98	0.00	0.00	0.00	9/27/05 11:02 AM	10/11/05 2:00 PM	338.98	0.00	0.00	0.00	338.98	43.55	0.00	0.00	0.00	43.55
22880	Hallway	H	339.73	339.73	0.00	0.00	0.00	9/27/05 10:17 AM	10/11/05 2:00 PM	339.73	0.00	0.00	0.00	339.73	84.13	0.00	0.00	0.00	84.13
24226	Hallway	H	339.73	339.73	0.00	0.00	0.00	9/27/05 10:17 AM	10/11/05 2:00 PM	339.73	0.00	0.00	0.00	339.73	112.93	0.00	0.00	0.00	112.93
21041	Hallway	H	339.68	339.68	0.00	0.00	0.00	9/27/05 10:20 AM	10/11/05 2:00 PM	339.68	0.00	0.00	0.00	339.68	79.20	0.00	0.00	0.00	79.20
21745	Hallway	H	339.67	339.67	0.00	0.00	0.00	9/27/05 10:21 AM	10/11/05 2:00 PM	339.67	0.00	0.00	0.00	339.67	99.10	0.00	0.00	0.00	99.10
24294	Hallway	H	339.67	339.67	0.00	0.00	0.00	9/27/05 10:21 AM	10/11/05 2:00 PM	339.67	0.00	0.00	0.00	339.67	81.27	0.00	0.00	0.00	81.27
23395	Lobby	LB	339.53	339.53	0.00	0.00	0.00	9/27/05 10:29 AM	10/11/05 2:00 PM	148.53	0.00	0.00	0.00	148.53	138.37	0.00	0.00	0.00	138.37
24644	Lobby	LB	339.55	339.55	0.00	0.00	0.00	9/27/05 10:28 AM	10/11/05 2:00 PM	339.55	0.00	0.00	0.00	339.55	154.65	0.00	0.00	0.00	154.65

Normalized Data Logger Detail Building type:Office. Building size:50K to less than 100K. Shifts:1

All Loggers Listed			Load	Normalized Weekly Hours of Use					Normalized Weekly Hours of Occupancy					
Logger	Area Type	Ty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav
23953	Lobby	LB	200	168.00	0.00	0.00	0.00	168.00	66.74	0.00	0.00	0.00	66.74	60.27%
24197	Hallway	H	84	168.00	0.00	0.00	0.00	168.00	49.56	0.00	0.00	0.00	49.56	70.50%
24134	Hallway	H	147	168.00	0.00	0.00	0.00	168.00	57.95	0.00	0.00	0.00	57.95	65.51%
23384	Hallway	H	147	168.00	0.00	0.00	0.00	168.00	36.13	0.00	0.00	0.00	36.13	78.49%
23905	Hallway	H	147	168.00	0.00	0.00	0.00	168.00	35.97	0.00	0.00	0.00	35.97	78.59%
24232	Hallway	H	120	168.00	0.00	0.00	0.00	168.00	0.18	0.00	0.00	0.00	0.18	99.89%
22363	Lobby	LB	200	167.95	0.00	0.00	0.00	167.95	72.13	0.00	0.00	0.00	72.13	57.05%
24133	Hallway	H	84	168.00	0.00	0.00	0.00	168.00	56.43	0.00	0.00	0.00	56.43	66.41%
23939	Hallway	H	147	168.00	0.00	0.00	0.00	168.00	35.60	0.00	0.00	0.00	35.60	78.81%
24258	Hallway	H	147	168.00	0.00	0.00	0.00	168.00	35.95	0.00	0.00	0.00	35.95	78.60%
24107	Hallway	H	147	168.00	0.00	0.00	0.00	168.00	35.82	0.00	0.00	0.00	35.82	78.68%
22559	Lobby	LB	200	168.00	0.00	0.00	0.00	168.00	67.25	0.00	0.00	0.00	67.25	59.97%
23838	Lobby	LB	200	168.00	0.00	0.00	0.00	168.00	21.58	0.00	0.00	0.00	21.58	87.15%
22880	Hallway	H	68	168.00	0.00	0.00	0.00	168.00	41.60	0.00	0.00	0.00	41.60	75.24%
24226	Hallway	H	68	168.00	0.00	0.00	0.00	168.00	55.85	0.00	0.00	0.00	55.85	66.76%
21041	Hallway	H	147	168.00	0.00	0.00	0.00	168.00	39.17	0.00	0.00	0.00	39.17	76.68%
21745	Hallway	H	147	168.00	0.00	0.00	0.00	168.00	49.02	0.00	0.00	0.00	49.02	70.82%
24294	Hallway	H	147	168.00	0.00	0.00	0.00	168.00	40.19	0.00	0.00	0.00	40.19	76.08%
23395	Lobby	LB	144	73.49	0.00	0.00	0.00	73.49	68.46	0.00	0.00	0.00	68.46	6.84%
24644	Lobby	LB	144	168.00	0.00	0.00	0.00	168.00	76.52	0.00	0.00	0.00	76.52	54.45%

Building Summary Totals Building type:Office. Building size:50K to less than 100K. Shifts:1

Building Summary Totals				Lights On KWHR					Occupied KWHR				
Area Type		Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
Hallway	H	14	1750	294	0	0	0	294	71	0	0	0	71
Lobby	LB	6	1086	165	0	0	0	165	67	0	0	0	67
Building Totals			2836	459			0	459	139			0	139