


Area Type Averages

Building type:Warehouse. Building size:50K to less than 100K. Shifts:2

Area Type Averages			Normalized Weekly Lights On					Normalized Weekly Occupied						
Area Type	Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav	
Warehouse	W	3	18240	43.25	0.00	0.00	0.00	43.25	9.90	0.00	0.00	0.00	9.90	77.11%
Open Lane	OL	2	18240	89.00	0.00	0.00	0.00	89.00	79.26	0.00	0.00	0.00	79.26	10.94%
Whse/Storage	WS	2	18240	79.27	0.00	0.00	0.00	79.27	51.69	0.00	0.00	0.00	51.69	34.79%
Building Average			127680	66.61			0.00	66.61	41.66			0.00	41.66	37.46%

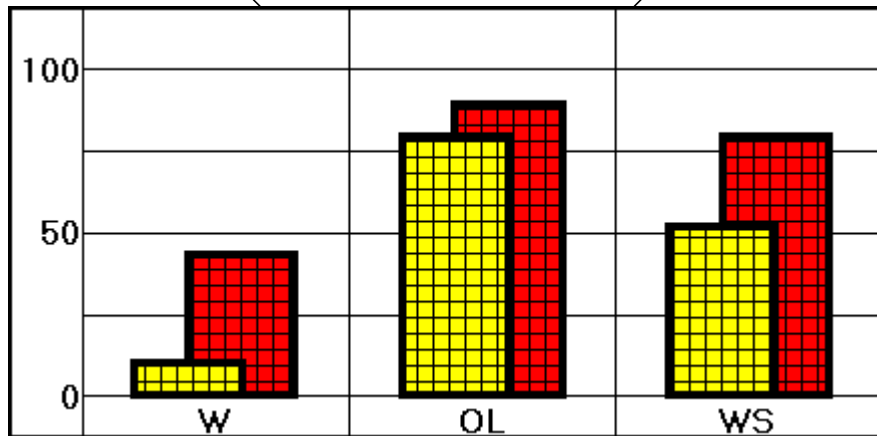

Hours per Week for each Area Type

Data Logger Detail Building type:Warehouse. Building size:50K to less than 100K. Shifts:2

All Loggers Listed			Hours Installed							Lights On					Occupied				
Logger	Area Type	Ty	Total	Peak	Off	Shldr 1	Shldr 2	Installed	Removed	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
20276	Warehouse	W	253.97	253.97	0.00	0.00	0.00	10/01/05 12:00	10/11/05 1:57 PM	71.27	0.00	0.00	0.00	71.27	17.87	0.00	0.00	0.00	17.87
20237	Workshop	WS	253.83	253.83	0.00	0.00	0.00	10/01/05 12:00	10/11/05 1:49 PM	135.07	0.00	0.00	0.00	135.07	94.80	0.00	0.00	0.00	94.80
20199	Warehouse	W	336.02	336.02	0.00	0.00	0.00	10/01/05 12:00	10/15/05 12:00	71.02	0.00	0.00	0.00	71.02	22.77	0.00	0.00	0.00	22.77
20296	Warehouse	W	254.02	254.02	0.00	0.00	0.00	10/01/05 12:00	10/11/05 2:00 PM	71.23	0.00	0.00	0.00	71.23	9.83	0.00	0.00	0.00	9.83
20278	Workshop	WS	89.73	89.73	0.00	0.00	0.00	10/01/05 12:00	10/04/05 5:43 PM	36.93	0.00	0.00	0.00	36.93	21.70	0.00	0.00	0.00	21.70
20415	Open Lane	OL	253.72	253.72	0.00	0.00	0.00	10/01/05 12:00	10/11/05 1:42 PM	135.03	0.00	0.00	0.00	135.03	121.00	0.00	0.00	0.00	121.00
20150	Open Lane	OL	253.82	253.82	0.00	0.00	0.00	10/01/05 12:00	10/11/05 1:48 PM	133.83	0.00	0.00	0.00	133.83	118.43	0.00	0.00	0.00	118.43

Normalized Data Logger Detail Building type:Warehouse. Building size:50K to less than 100K. Shifts:2

All Loggers Listed			Load	Normalized Weekly Hours of Use					Normalized Weekly Hours of Occupancy					
Logger	Area Type	Ty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav
20276	Warehouse	W	18240	47.14	0.00	0.00	0.00	47.14	11.82	0.00	0.00	0.00	11.82	74.93%
20237	Workshop	WS	18240	89.39	0.00	0.00	0.00	89.39	62.74	0.00	0.00	0.00	62.74	29.81%
20199	Warehouse	W	18240	35.51	0.00	0.00	0.00	35.51	11.38	0.00	0.00	0.00	11.38	67.95%
20296	Warehouse	W	18240	47.11	0.00	0.00	0.00	47.11	6.50	0.00	0.00	0.00	6.50	86.20%
20278	Workshop	WS	18240	69.15	0.00	0.00	0.00	69.15	40.63	0.00	0.00	0.00	40.63	41.24%
20415	Open Lane	OL	18240	89.41	0.00	0.00	0.00	89.41	80.12	0.00	0.00	0.00	80.12	10.39%
20150	Open Lane	OL	18240	88.58	0.00	0.00	0.00	88.58	78.39	0.00	0.00	0.00	78.39	11.50%

Building Summary Totals Building type:Warehouse. Building size:50K to less than 100K. Shifts:2

Building Summary Totals				Lights On KWHR					Occupied KWHR				
Area Type	Qty	Watts		Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
Warehouse	W	3	54720	2367	0	0	0	2367	542	0	0	0	542
Open Lane	OL	2	36480	3247	0	0	0	3247	2891	0	0	0	2891
Whse/Storage	WS	2	36480	2892	0	0	0	2892	1886	0	0	0	1886
Building Totals			127680	8505			0	8505	5319			0	5319